

APP CRS
170°

Rwy Idg 10000
TDZE 485
Apt Elev 501

RNAV (RNP) Z RWY 17R

LOUISVILLE MUHAMMAD ALI INTL (SDF)

RNP AR APCH - GPS.


▼

For uncompensated Baro-VNAV systems, procedure NA below -13°C or above 54°C.
Simultaneous approach authorized.
For inop ALS, increase RNP 0.30 visibility all Cats to 1½ SM.

MALSR

MISSED APPROACH: Climb to 1600 then climbing right turn to 4000 direct DAMEN and hold.

D-ATIS 118.725	LOUISVILLE APP CON 132.075 327.0	LOUISVILLE TOWER 124.2 257.8	GND CON 121.7 348.6	CLNC DEL 126.1 275.8	CPDLC
-------------------	-------------------------------------	---------------------------------	------------------------	-------------------------	-------

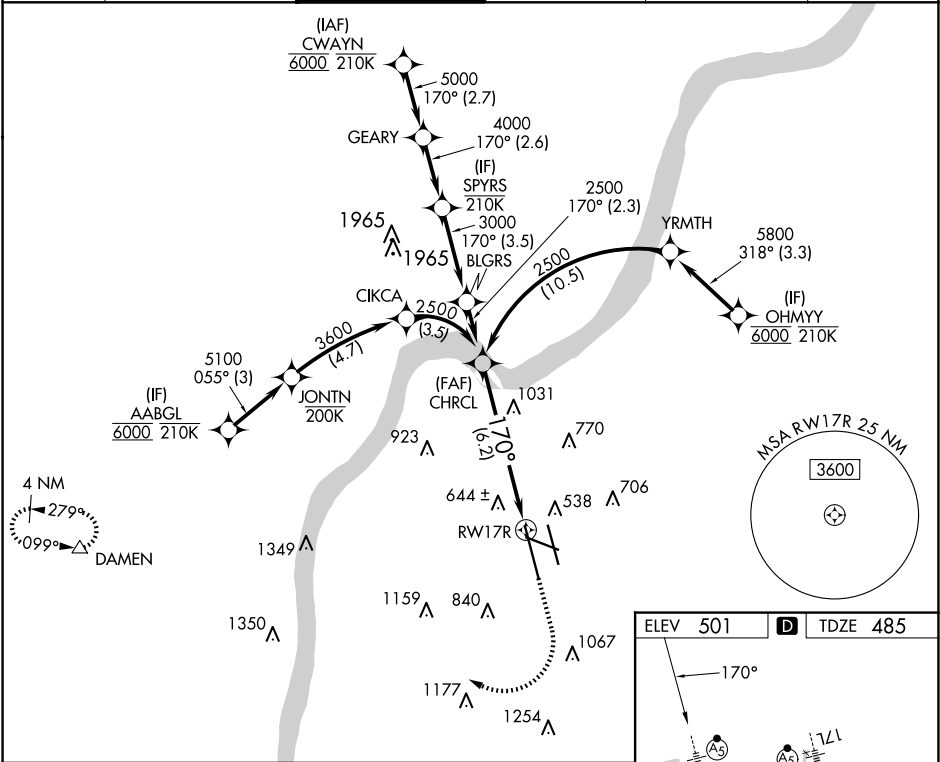

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 64).

1600

4000

DAMEN

See planview for multiple IF locations.

2500

170°

GP 3.00°
TCH 50

6.2 NM

RW17R

CATEGORY	A	B	C	D
RNP 0.30 DA	974/50 489 (500-1)			

AUTHORIZATION REQUIRED

HIRL all Rwys
TDZ/CL Rwys 17L, 17R, 35L and 35R