

APP CRS
183°

Rwy Idg **10000**
TDZE **742**
Apt Elev **748**

RNAV (RNP) Z RWY 18C
CHARLOTTE/DOUGLAS INTL (CLT)


RNP AR APCH.

Simultaneous approach authorized. For uncompensated Baro-VNAV systems, procedure NA below -11°C or above 54°C.

MALSR

MISSED APPROACH: Climb to 3000 direct DENNE and hold.

D-ATIS	CHARLOTTE APP CON	CHARLOTTE TOWER	GND CON	CLNC DEL
ARR 121.15	(001°-119°) 128.325	(Rwys 18L-36R) 118.1 257.8	121.8 348.6 (WEST)	127.15
DEP 132.1	(120°-295°) 120.05	(Rwy 18C-36C) 126.4 257.8	121.9 348.6 (EAST)	348.6
	(296°-360°) 134.75	(Rwy 18R-36L) 133.35 257.8		
	(180°-359°) 257.2			
	(360°-179°) 307.8			

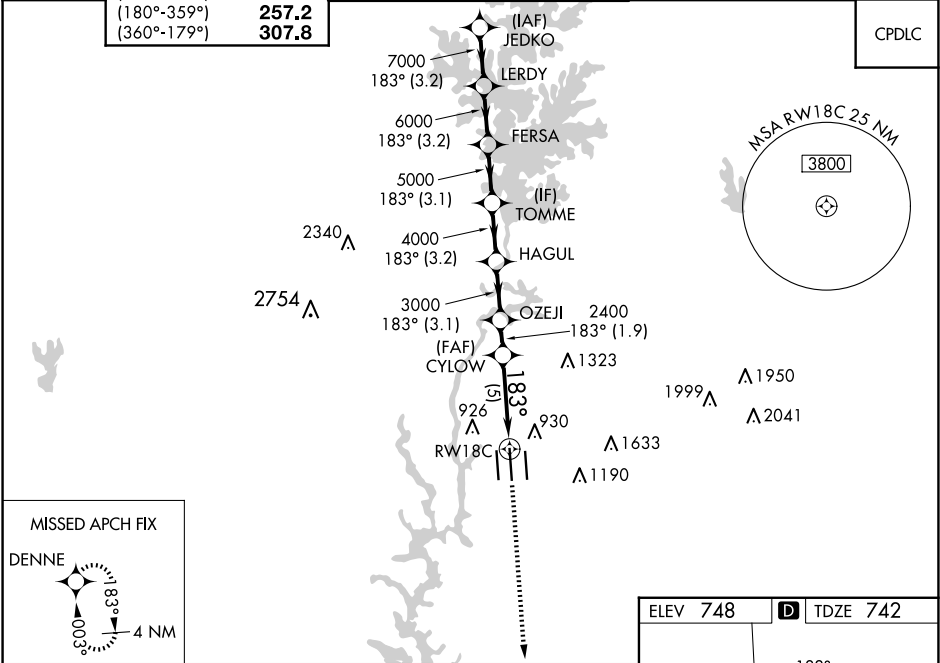

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 69).

3000 DENNE

JEDKO	LERDY	FERSA	TOMME	HAGUL	OZEJI	CYLOW	RWY 18C
8000	7000	6000	5000	4000	3000	2400	
GP 3.00°							
TCH 55							
	3.2 NM	3.2 NM	3.1 NM	3.2 NM	3.1 NM	1.9 NM	5 NM
CATEGORY	A		B		C		D
RNP 0.11 DA	1067/26		325 (400-½)				
RNP 0.30 DA	1177/40		435 (500-¾)				

AUTHORIZATION REQUIRED

ELEV 748

D TDZE 742

183°

896

181

0.6% DOWN

10000 X 150

0.4% UP

9000 X 150

36L

36C

TWR 1068

36R

HIRL all Rwys

REIL Rwys 18L and 23

TDZ/CL Rwys 18R, 36L, 36C and 36R