

APP CRS
238°

Rwy Idg **12000**
TDZE **30**
Apt Elev **30**

RNAV (RNP) Z RWY 24
SOUTHWEST FLORIDA INTL (RSW)

RNP AR APCH - GPS


▼

For uncompensated Baro-VNAV systems, procedure NA below 4°C or above 54°C.

MISSED APPROACH: Climb to 500 then climbing left turn to 2300 direct CORFU and hold, continue climb-in-hold to 2300.

D-ATIS 124.65	FORT MYERS APP CON ★ 125.15 306.2 (RWY 6) 126.8 306.2 (RWY 24)	FORT MYERS TOWER ★ 128.75 (CTAF) 0 257.8	GND CON 121.9 257.8	CLNC DEL 132.075	UNICOM 122.95
-------------------------	--	---	-------------------------------	----------------------------	-------------------------

CPDLC

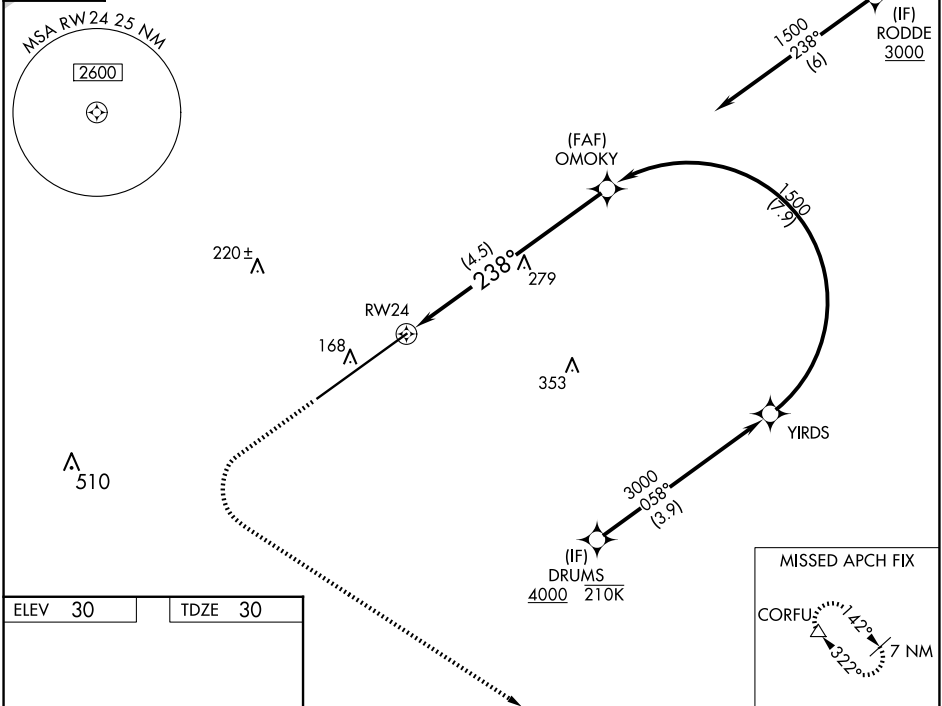

ELEV 30

TDZE 30

238°

500

2300

CORFU

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 72).

OMOKY 1500

1500

GP 3.00° TCH 52

4.5 NM

See Planview for multiple IF locations.

RW24

238°

2000 x 150

TWR 239

83

AS

CATEGORY	A	B	C	D
RNP 0.11 DA	294-7/8 264 (300-7/8)			
RNP 0.30 DA	397-1 367 (400-1)			

AUTHORIZATION REQUIRED

REIL Rwy 24
TDZ/CL Rwy 6
HIRL Rwy 6-24

Fort Myers Airport Diagram

SE-3, 12 JUN 2025 to 10 JUL 2025

SE-3, 12 JUN 2025 to 10 JUL 2025